
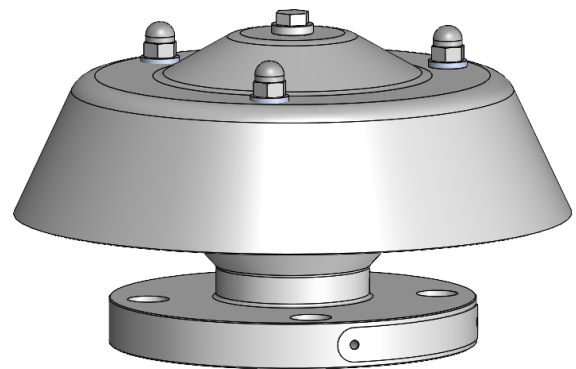


End of Line Deflagration Flame Arrester	: 1008-0030-71
EC design test certificate no.	: EPT 24 ATEX 5584 X
Standard gap (MESG)	: < 0,50 mm
Explosion group	: Ex G IIC
Flange connection PN10(40)	: EN1092-1 Form B1 (DIN2576)
Weight	: ~ 6,4 kg
Option	:

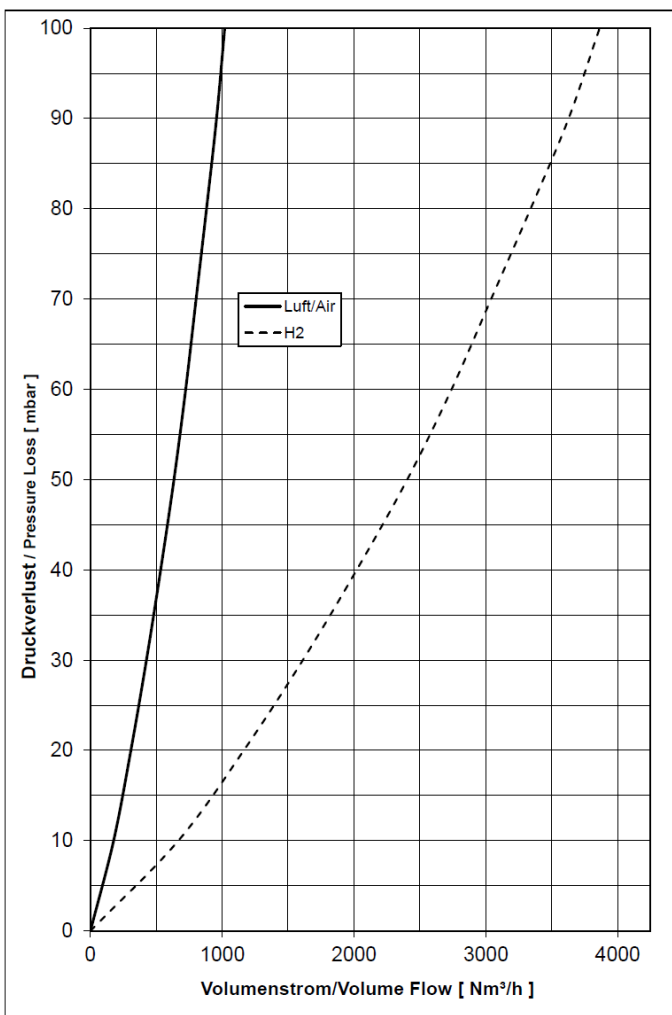

Material

Housing

V4A/AISI 316 range

Flame Arrester Element

1.4571 / AISI 316 Ti

Operating Data

Type	: DEF
Absolute pressure	: $\leq 1,1$ bar
Temperature	: $\leq 60,0$ °C
Nominal pipe size	: $\leq$ DN50

Pressure loss

Medium Air

$p_0 = 1013$ mbar, $T_0 = 273$ K, density = $1,293$ kg/m³